



Contactless Measurement of Level

LB 440



P R O C E S S C O N T R O L

Level Gauge LB 440

The measuring system **LB 440** is used for the **contactless, continuous** measurement of liquids and bulk materials in reactors, vessels and bunkers. The measurement is not

affected by the chemical and physical properties of the product being measured. The level measurement is adapted to the specific geometry of the vessel.

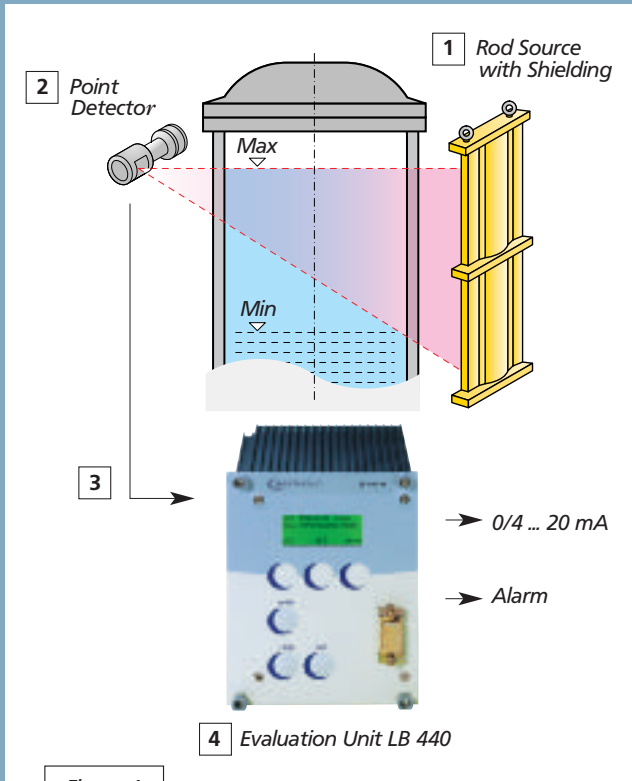


Figure 1

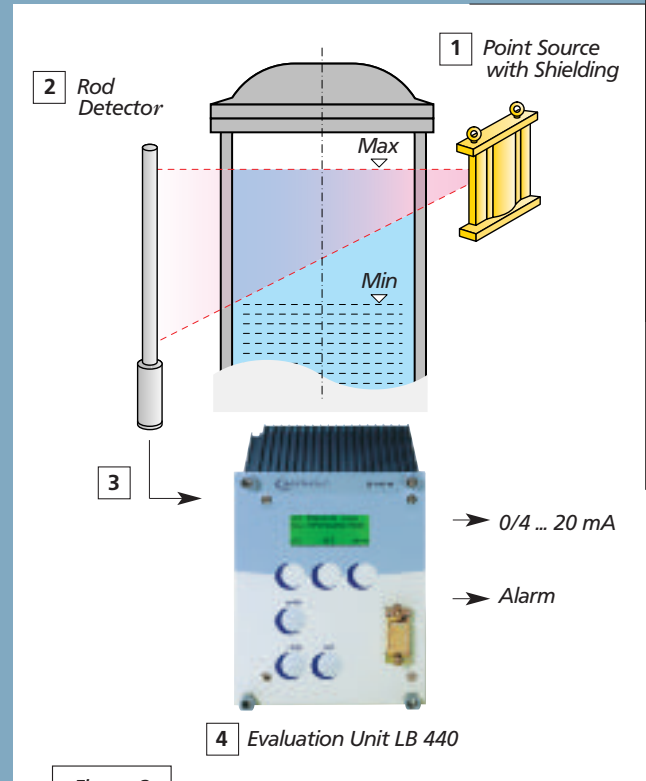


Figure 2

Measuring Arrangement

Figures 1 and 2 show schematic layouts of typical measuring arrangements. It is comprised of the source **1** mounted on the outside of the container, a detector **2** and the connection cable **3** from the detector to the evaluation unit LB 440 **4**. Source and detector form a radiation field corresponding to the size of the measuring range. This can be achieved by using a rod-shaped source and a point detector (Fig. 3) or a point-shaped source and a rod detector (Fig. 4), for special

applications a rod source and rod detector (Fig. 5) can be used. Which of these options is selected is dependent upon the measuring geometry, the measuring task, ambient factors or even considerations of space and money. For larger measurement ranges several rod detectors can be used together in a line. Signals from individual detectors are transmitted via slave units to a master evaluation unit for indication of product level.

General Arrangements

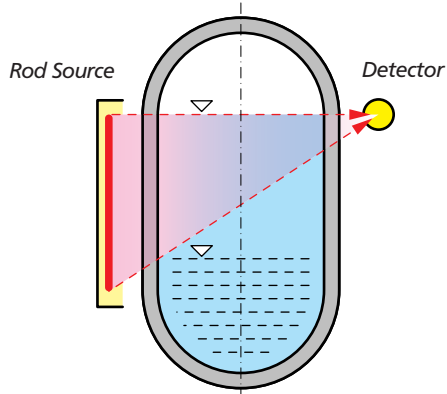


Figure 3: Rod Source

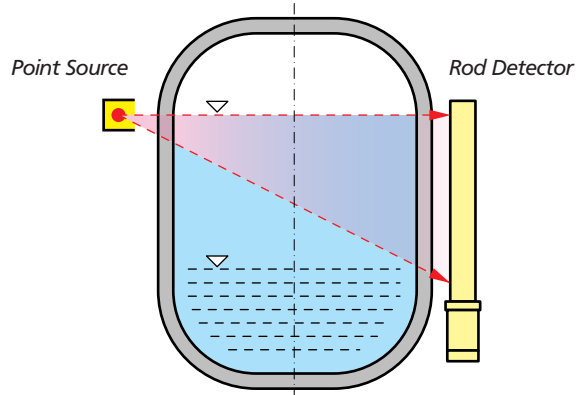
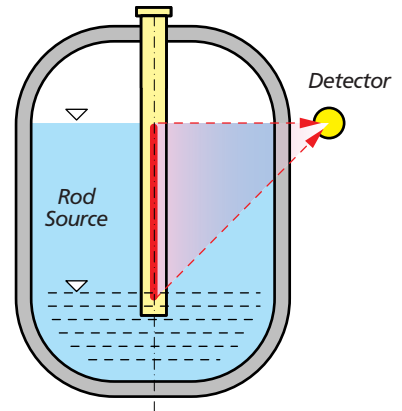


Figure 4: Rod Detector



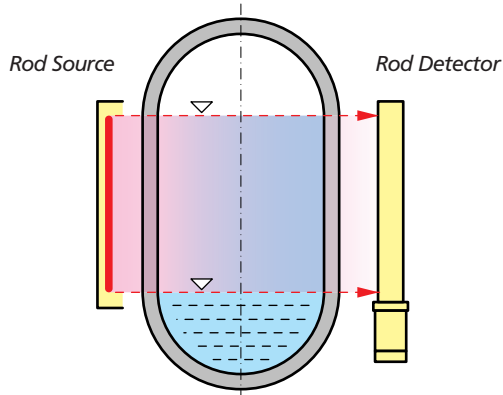


Figure 5: Rod Source with Rod Detector

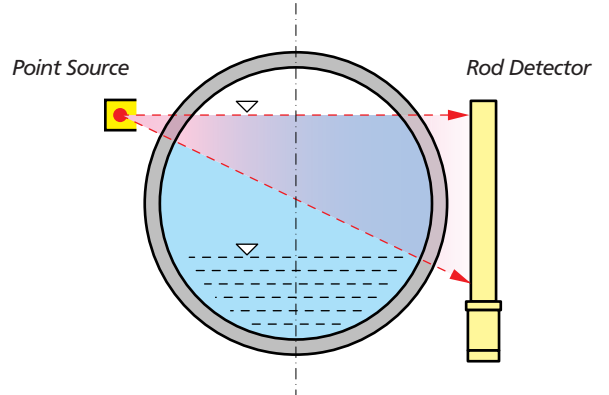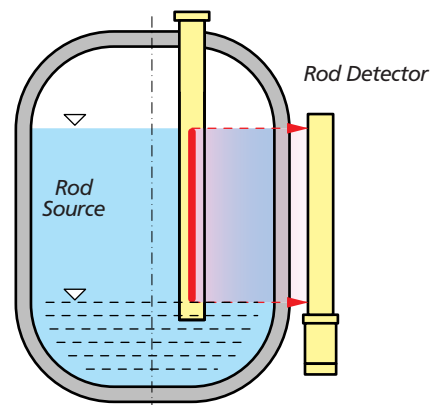

Evaluation Unit LB 440


The evaluation unit incorporates state of the art microprocessor technique with 32-bit processor for high computing performance and high accuracy together with most simple operation. The software is tailored to the measuring principle. More than 40 years of experience in the field of radiometric measurement technique are consequently utilized.

In addition, the evaluation unit features:

- Compact design in 19"-module (3HE; 21 TE) for installation in a wall housing or 19"racks.
- Illuminated 4-line LCD-display.
- Operation via 6 membrane keys.
- Convenient multilingual and user-guided dialog via "softkeys".
- Continuous self-monitoring of the electronics.
- Data protection without battery backup by saving all calibration data to a FLASH-Memory.

Source with Shielding

All radioactive sources used for industrial applications are encapsulated in stainless steel, so that radioactive substance is kept separate and isolated from the material being measured. Depending on the measuring task, one can either work with ^{60}Co or ^{137}Cs sources. The radioactive material of the ^{60}Co rod source is a metal wire wound around a mandrel of the required length. By winding at a variable pitch, any linearization can be achieved, even for complicated measuring geometries. Depending on the measuring task, either ^{60}Co or ^{137}Cs are selected as point sources. The sources are built into sturdy shieldings which include a lockable radiation exit slit that is directed toward the detector. The shielding is adapted to the required activity so that operating personnel are never exposed to any

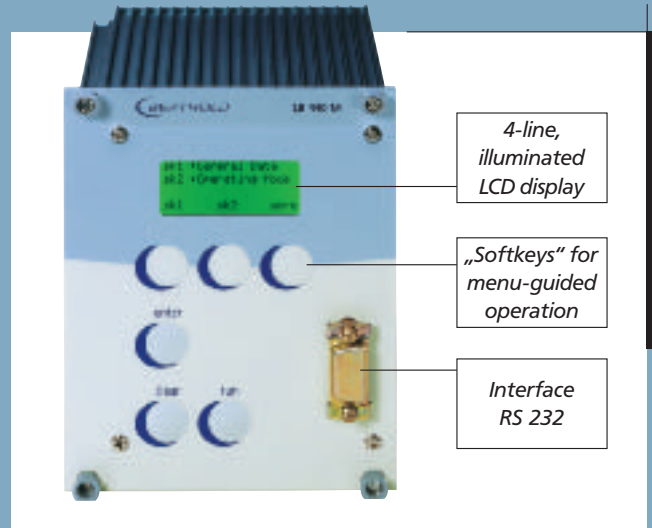

4-line,
illuminated
LCD display

„Softkeys“ for
menu-guided
operation

Interface
RS 232

excessive radiation levels. For rod sources as well as for point sources, the shielding is installed **vertically** on a bracket. The radiation channel is specially designed for this measuring arrangement. This ensures a simple and non-critical installation.

Detectors

Typically, scintillation counters are used as radiation detectors for continuous level measurements. These detectors consist of a NaI crystal; the scintillator of rod detectors are made of plastic. Flashes of light are created in the detector by the radiation. The number of flashes is proportional to the intensity of the radiation field. The crystal is optically coupled to a photomultiplier which, together with the electronics, converts the flashes of light into electrical pulses. The special benefits of scintillation counters are their high sensitivity to Gamma radiation, low source activity and unlimited useful life. The signals are transferred to the evaluation unit via two-wire technique with ASK-modulation to ensure a high level of interference immunity.

Contactless Measurement

Principles of Measurement

The Level Gauge LB 440 operates according to radiometric principle, utilizing the physical law that gamma radiation is attenuated as it passes through matter. Since the source type and the absorption path are constant in this case, the measurement is affected only by the presence of the medium. All other physical properties such as pressure, temperature, viscosity and colour have no influence. Since the absorption law follows an exponential curve, the measuring effect with normal container dimensions becomes practically independent of any density changes in the medium being measured.

As a consequence, the radiometric measuring method features a very high level of operational safety and requires practically no maintenance, even under difficult operating and ambient conditions. The use of scintillation counters as radiation detectors and careful project engineering ensure that the lowest possible source activities and the best shieldings will be used. The radiation exposure of the operating staff will clearly stay below the extremely low values permitted by law, which are about as high as the natural environmental radiation. The use of radiometric measuring systems has to comply with the applicable radiation protection regulations.


Project Engineering

When designing the level gauging system, the special features of the production process and possible contingent conditions should be taken into account, in addition to the actual measuring task. Relevant data along with dimensional drawings should therefore be provided.


Engineering Data

- Type and dimensions of the vessel
- Wall thickness and wall material
- Thickness and density of any insulation
- Size and position of the required measuring range
- Density and any special properties of the medium in vessel
- Gas density under operating conditions in high pressure systems
- Maximum speed of level variations
- Ambient temperature at the detector
- Agitators or other internals, if any

Other Applications from Berthold

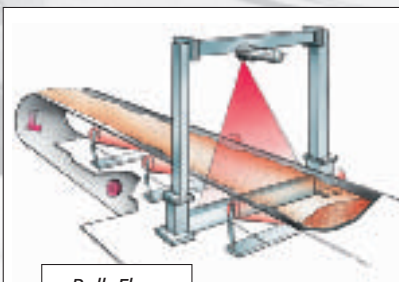

Bulk Flow

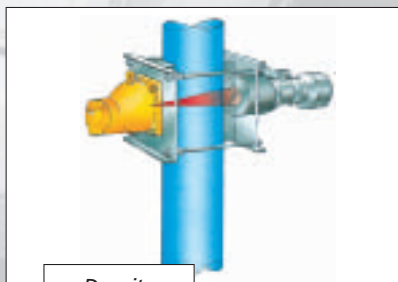

Density



Moisture

Technical Data LB 440

Evaluation Unit LB 440

| | |
|-------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Design | 19" module 3 HE, 21 TE protection class IP 20 |
| Weight | approx. 2 kg |
| Power supply | 115/230 V AC +/- 10 % 18-32 V DC, 24 V AC |
| Power consumption | approx. 30 VA (AC) 30 W (DC) |
| Operating temp. | 0 ... +50° C (273 bis 323 K) no condensation |
| Storage temp | -40 ... +70° C (233 bis 343 K) no condensation |
| Arrangements | in a panel in a 19" rack (max 4 Units) wall mounted cabinet |
| Detector connection | [EEx ib] IIB [EEx ib] IIC (Option) |
| Digital inputs | external start/stop |
| Digital output | 1 relay for failure message 2 relays for threshold max load: (non inductive) AC: max. 250 V, max. 1 A, max. 200 VA DC: max. 300 V, max. 1 A, max. 60 W |
| Interfaces | RS 232 on front site / RS 485 rear |
| Multi lingual operation | English, German, French |

Design modifications may occur without notice

Probes

| | | |
|-------------------|--------------------------------------|------------|
| Housing | Nema 4X and IP 65 Stainless Steel | |
| Cable entrance | M16 | M12 |
| Cable diameter | 5 ... 10 mm | 4 ... 7 mm |
| Connection cable | LiYCY 2 x 1 mm ² | |
| Max. cable length | with Berthold cable #32024 | |
| | EEx ib IIB | EEx ib IIC |
| | 1000 m | 250 m |

Explosion Proof

| | |
|-------------------|----------------------------------------------------------------------------------------------------|
| ATEX | II 2G EEx ib d IIC T6 |
| Dust (on request) | II 2 D IP65 T 80° C |
| FIM (option) | Class I Division 1 Group A, B, C, D Class II Division 1 Group E, F, G Temp. Class T6 (85° C) |

| | | | | |
|---------------------|---------------------------------|--|--|--|
| Point Probes | NaI (TI) Scintillation counters | | | |
| Temp. stability | +/- 0,1 % (at -20 ... +50° C) | | | |
| Operating temp. | - 40 ... +60° C (233 ... 333 K) | | | |
| Water cooling | option | | | |
| Storage temp. | - 40 ... +70° C (233 ... 343 K) | | | |

| Type | Crytall size | EEx | Dose rate (µSv/h) for 300 cps | Weight (kg) |
|------------|--------------|-----|----------------------------------|-------------|
| LB 4401-01 | 25/25 | x | 2,7 | 6 |
| LB 4401-02 | 40/35 | x | 1,1 | 6 |
| LB 4401-03 | 50/50 | x | 0,5 | 18 |
| LB 5401-01 | 25/25 | | 2,7 | 6 |
| LB 5401-02 | 40/35 | | 1,1 | 6 |
| LB 5401-03 | 50/50 | | 0,5 | 18 |

| | | | | |
|----------------------|---------------------------------|--|--|--|
| Rod Detectors | Plastic scintillation counters | | | |
| Temp. stability | +/- 0,5 % (at -20 to +50° C) | | | |
| Operating/ | | | | |
| Storage temp. | - 40 ... +55° C (233 ... 328 K) | | | |
| Water cooling | option | | | |

Typical dose rate at empty: 1µSv/h

| Type | Sensitive detector length (mm) | Dose rate (µSv/h) 1000 cps | Weight (kg) without water cooling | Weight (kg) with water cooling |
|------------|--------------------------------|-------------------------------|--------------------------------------|-----------------------------------|
| LB 4405-01 | 500 | 0,17 | 9 | 11,5 |
| LB 4405-02 | 750 | 0,15 | 10,5 | 14 |
| LB 4405-03 | 1000 | 0,09 | 12 | 17 |
| LB 5405-04 | 1250 | 0,07 | 13,5 | 19,5 |
| LB 5405-05 | 1500 | 0,06 | 15 | 22 |
| LB 5405-06 | 2000 | 0,04 | 16,5 | 25 |

